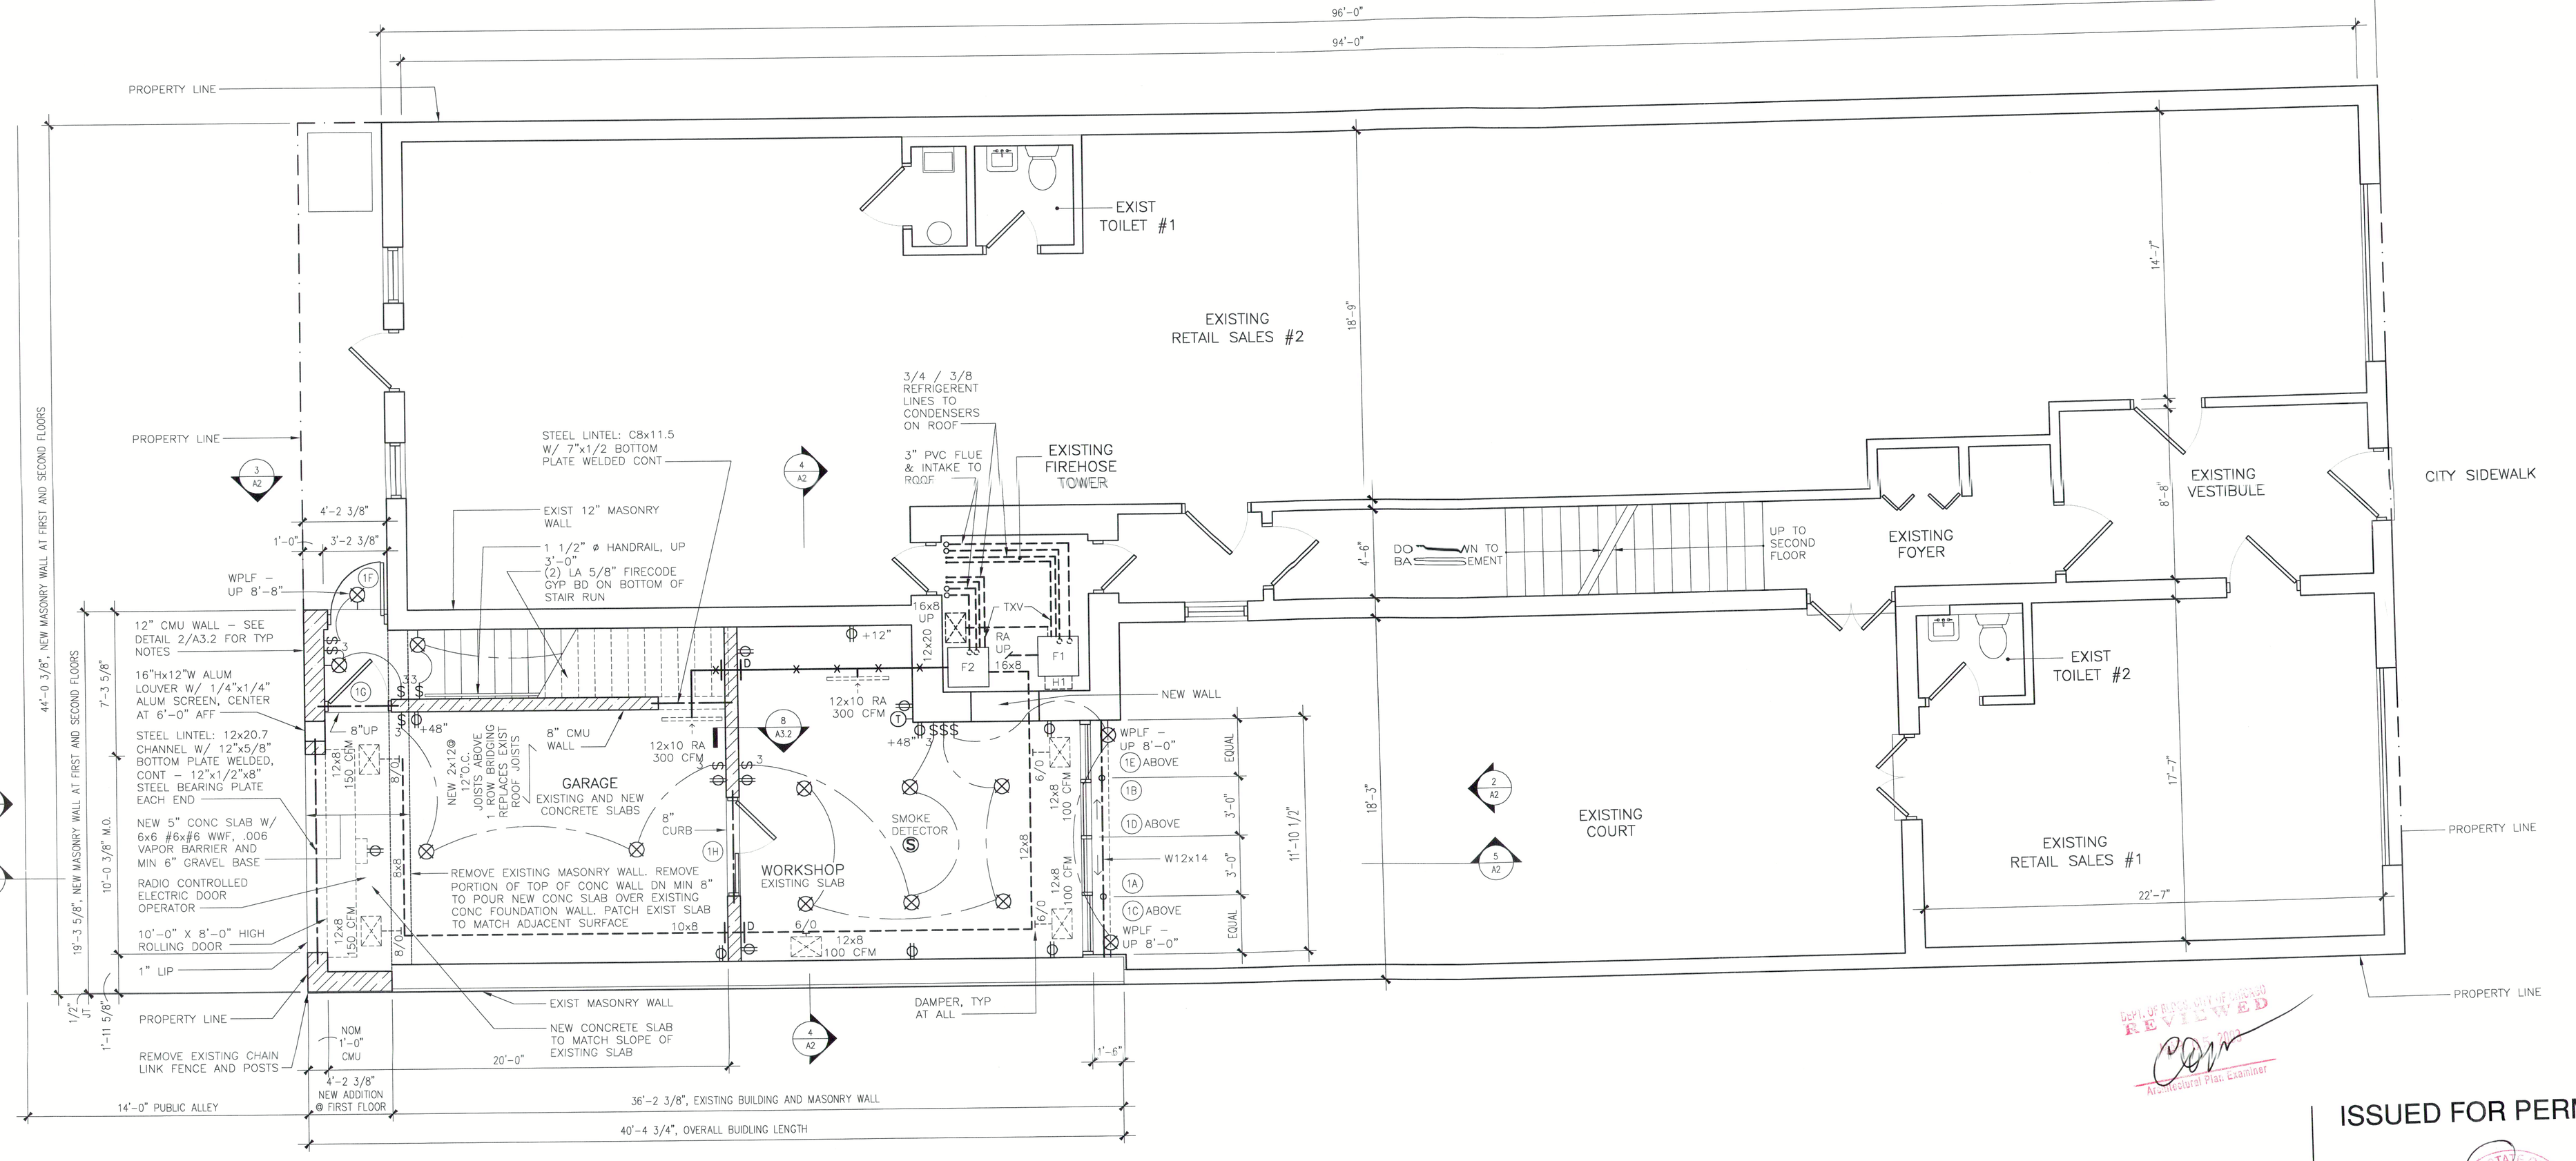

1 FIRST FLOOR PLAN
1/4"=1'-0"

NOTE:

SEE SHEET A1.4 FOR CHICAGO VENTILATION NOTES AND NEW EQUIPMENT SCHEDULE

NATURAL LIGHT/VENTILATION SCHEDULE

	USE OF SPACE	AREA	NATURAL VENTILATION: CODE REQUIREMENT	NATURAL VENTILATION: % FLOOR AREA REQ'D	NATURAL VENTILATION: % FLOOR AREA PROVIDED	NATURAL LIGHT: CODE REQ'D (% OF FLOOR AREA)	NATURAL LIGHT: % FLOOR AREA REQ'D	NATURAL LIGHT: % FLOOR AREA PROVIDED	REMARKS
FIRST FLOOR	GARAGE	528	NR	–	–	NR	–	–	

HEATING SCHEDULE (NEW ADDITION)

USE OF SPACE/ ROOM NAME	BASIS OF HEAT LOSS CALCULATIONS	DESIGN HEAT LOSS (BTUH HEAT LOSS)	ORDINANCE REQUIREMENTS (SUPPLY CFM AT 175 F)	ACTUAL HEAT PROVIDED (SUPPLY CFM AT 175 F)
GARAGE	ASHRAE	32,420	NA	600
	TOTALS	32,420		600
SITTING	ASHRAE	30,085	55	500
LOFT	ASHRAE	12,150	25	300
	TOTALS	42,235		800

NORTH

DEPARTMENT OF BUILDINGS REVIEWED
3-27-03
Architectural Plan Examiner

3-27-03

ISSUED FOR PERMIT

01.08.03 PERMIT REVISIONS

No.	Date	Issue

1242–1244 N. WELLS ST. BLDG.

CHICAGO, IL

LEONARD WISNIEWSKI, ARCHITECT

2834 N. STATE ROUTE ONE
MARTINTON TOWNSHIP, ILLINOIS 60951
TEL: 815.428.7556

FIRST FLOOR PLAN, FIRST FLOOR LIGHT AND VENTILATION SCHEDULE & HEATING SCHEDULE

Scale: 1/4 = 1'-0"
Date: 10.15.02
File: 0205\A1-2

A1.2